

## Annexure C

Appendix-XIII

## PROFORMA FOR SAFE DRINKING WATER AND SANITARY CONDITION CERTIFICATE

No.

Dated:

It is certified that an inspection team headed by ..... Lakhhir Singh, SI .....  
(Name of Officers with designation) from ..... O/c Civil Surgeon Ropar .....  
(Name of Department/ Office) inspected the ..... Netaji Model School, Hargobind .....  
(Name & Address of the school) on ..... 12/03/2025 ..... (date of inspection), checked the water test report  
submitted by the school and found that the school has potable drinking water for students and staff of the  
institution and is having provision for running water in the toilets and maintaining hygienic sanitation  
condition in the school building & the campus as per norms prescribed by the Central/ State/ U.T. Govt.  
The above is valid for a period of ..... 1 year .....

Signature with Seal: .....

Name : .....

Designation : .....

Assistant Engineer of  
the Govt. Public Health Department (PHED)/  
Authorised officer of the Local Body

Name &amp; Address of the Office / Department : ...

To

Netaji Model School  
Hargobind Nagar Ropar.

(Name &amp; Address of the Institution)

\* The filled up certificate should be either in Hindi or English. If it is issued in vernacular language, translated notarized version in English be uploaded along with the original vernacular certificate as a single pdf.

58 | Page

Principal  
NETAJI MODEL SCHOOL  
Rupnagar (Pb.)  
S. Code : 20110

Director  
Netaji Model School  
ROPAR (Pb.)

**DISTRICT WATER TESTING LABORATORY, ROOPNAGAR**

Department of Water Supply and Sanitation, Division -2, Roopnagar  
dwtlrpr@gmail.com

**TEST REPORT**

Name & Address of Customer : Netaji Model School, Hargobind Nagar Netaji Model School, Hargobind Nagar, Roopnagar		Customer Reference No.	No : Letter No. 20110/NJMS/302/DW/F25 Dated : 12/03/2025
		Sample Submitted by	Bharati Saini
		Date of Sample Receipt	12/03/2025
		Analysis Starting Date	20/03/2025
		Analysis completion Date	25/03/2025
Discipline : Chemical Testing		Group: Water	
ULR No.:	TC98822500000098F	Sample Type :	Water
Test Report No.:	DWTLRPR/2425/00415	Date of Issue :	25/03/2025
Registration no.:	DWTLRPR/REG2425/00932	Condition of Sample :	Unsealed
Collection Point:	Distribution Point(Near Bus stand, School, Gurudwara, etc)	Quantity/Type of Bottle:	1000 ml / HDPE Bottle
Scheme/Source:	Not Mentioned(Not Mentioned)	Location/Depth :	Netaji Model School, Hargobind Nagar, Roopnagar (TAP WATER) / NA
Village :	Not Mentioned	Habitation :	Not Mentioned
Block:	Not Mentioned	District :	Roopnagar
Latitude :	Not Mentioned	Longitude:	Not Mentioned

Sr. No	Parameter	Result	As per IS-10500:2012 (2nd Rev.)		Unit	Reference Method :
			Acceptable Limit	Permissible Limit		
1	pH	6.85@25°C	6.5-8.5	No Relaxation	--	IS 3025 (Part 11-2022) Electrometric Method
2	Colour	<5	5	15	CU	IS 3025(Part 4-2021) Visual Comparison Method
3	Odour	Agreeable	Agreeable	Agreeable	--	IS 3025 (Part 5 – 2018) (Second Revision)
4	Taste	NT	Agreeable	Agreeable	--	IS 3025 (Part 8 – 2023)
5	TDS	195	500	2000	mg/l	IS 3025 (Part 16-2023) Gravimetric Method
6	Turbidity	1.81	1	5	NTU	IS 3025 (Part 10-2023) Nephelometric Method
7	Alkalinity(CaCO <sub>3</sub> )	172	200	600	mg/l	IS 3025 (Part 23-2023) Indicator Method
8	Hardness(CaCO <sub>3</sub> )	112	200	600	mg/l	IS 3025 (Part 21- 2009)(RA 2023) EDTA Method
9	Calcium(Ca)	19.24	75	200	mg/l	IS 3025 (Part 40-2024) EDTA Titrimetric Method
10	Magnesium(Mg)	15.55	30	100	mg/l	APHA (24th Ed.2023) Method: 3500-Mg+2 B By Calculation Method
11	Chloride(Cl)	11	250	1000	mg/l	IS 3025 (Part 32-1988) Argentometric Method


This Report is issued under the following terms & Condition :

1. The results apply to the sample as received only.
2. The sample will be destroyed after retention time unless otherwise specified specially.
3. This report is not to be reproduce wholly or in part and can't be used as evidence in court of law.
4. Abbreviation used (TDS = Total Dissolved Solids, mg/l = milligram per liter, BDL = Below detection limit, APHA = American Public Health Association, IS = Indian Standard, NT = Not Tested, NA = Not Applicable NTU = Nephelometric Turbidity Unit, RA = Reaffirmed, ND=Not Detected)
5. \* Value not available or test not performed for this parameter.
6. Temperature condition limit: 25±5°C and Humidity condition limit:50 ±20%

Reviewed and Approved By




Mr. Praveen Singh Danu  
Chemist/Analyst  
Authorized Signatory  
For, District Water Testing Laboratory  
Roopnagar



Principal  
NETAJI MODEL SCHOOL  
Rupnagar (Pb.)  
S. Code : 20110

End of the Test Report

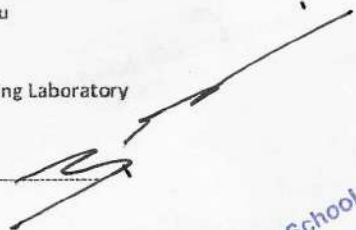

Director  
Netaji Model School  
ROPAR (Pb.)



**DISTRICT WATER TESTING LABORATORY, ROOPNAGAR**  
Department of Water Supply and Sanitation, Division -2 , Roopnagar  
dwtlrpr@gmail.com

**Payment Receipt**

Receipt No. : 22908

Date : 19/03/2025

Invoice No. : INV/2425/00382

Invoice Date : 19/03/2025

Received From : Netaji Model School, Hargobind Nagar  
Netaji Model School, Hargobind Nagar, Roopnagar

The Sum of Rupees : One Hundred Thirty Only.

In Cash

Rs. : 130.00

Disclaimer: -Payment made by cheque/online mode are subject to clearance by bank.

*Harpreet Singh*

For District Water Testing Laboratory, Roopnagar  
Authorized Signatory

Principal  
NETAJI MODEL SCHOOL  
Rupnagar (Pb.)  
S. Code : 20110

*[Signature]*

Principal  
NETAJI MODEL SCHOOL  
Rupnagar (Pb.)  
S. Code : 20110

*[Signature]*  
Director  
Netaji Model School  
ROPAR (Pb.)

**DISTRICT WATER TESTING LABORATORY, ROOPNAGAR**

Department of Water Supply and Sanitation, Division -2, Roopnagar  
dwtlrpr@gmail.com

To,

Netaji Model School, Hargobind Nagar  
Netaji Model School, Hargobind Nagar, Roopnagar


No.: DWTLRPR/2425/00415 Dated : 25/03/2025

Subject : Testing Reports of Water Samples.


Reference: Your Letter/SRF No. Letter No. 20110/NJMS/302/DW/F25 Dated: 12/03/2025

As per above cited subject and reference, Please find enclosed here with the report of 1 Water sample/s received on dated 12/03/2025. It is request to fill the attached feedback form and send it back to District Water Testing Laboratory, Roopnagar

D/A : Test Report



Authorized Signatory  
For, District Water Testing Laboratory  
Roopnagar



Principal  
NETAJI MODEL SCHOOL  
Rupnagar (Pb.)  
S. Code : 20110



Director  
Netaji Model School  
ROPAR (Pb.)